SIEMENS

Data sheet

3RU2116-1DB0



Overload relay 2.2...3.2 A Thermal For motor protection Size S00, Class 10 Contactor mounting Main circuit: Screw Auxiliary circuit: Screw Manual-Automatic-Reset

we do at here do a ser	
product brand name	SIRIUS
product designation	thermal overload relay
product type designation	3RU2
General technical data	
size of overload relay	S00
size of contactor can be combined company-specific	S00
power loss [W] for rated value of the current at AC in hot operating state	5.7 W
• per pole	1.9 W
insulation voltage with degree of pollution 3 at AC rated value	690 V
surge voltage resistance rated value	6 kV
maximum permissible voltage for protective separation in networks with grounded star point	
 between auxiliary and auxiliary circuit 	440 V
 between auxiliary and auxiliary circuit 	440 V
 between main and auxiliary circuit 	440 V
 between main and auxiliary circuit 	440 V
shock resistance according to IEC 60068-2-27	8g / 11 ms
type of protection according to ATEX directive 2014/34/EU	Ex II (2) GD
certificate of suitability according to ATEX directive 2014/34/EU	DMT 98 ATEX G 001
reference code according to IEC 81346-2	F
Substance Prohibitance (Date)	10/01/2009
Ambient conditions	-
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
 during operation 	-40 +70 °C
 during storage 	-55 +80 °C
during transport	-55 +80 °C
temperature compensation	-40 +60 °C
relative humidity during operation	10 95 %
Main circuit	
number of poles for main current circuit	3
adjustable current response value current of the current-dependent overload release	2.2 3.2 A
operating voltage	
 rated value 	690 V
 at AC-3e rated value maximum 	690 V
operating frequency rated value	50 60 Hz

onorational aurrent rated value	2.2.4
operational current rated value	3.2 A
operational current at AC-3e at 400 V rated value	3.2 A
operating power	
• at AC-3	
— at 400 V rated value	1.1 kW
— at 500 V rated value	1.5 kW
— at 690 V rated value	2.2 kW
• at AC-3e	
— at 400 V rated value	1.1 kW
— at 500 V rated value	1.5 kW
— at 690 V rated value	2.2 kW
Auxiliary circuit	
design of the auxiliary switch	integrated
number of NC contacts for auxiliary contacts	1
• note	for contactor disconnection
number of NO contacts for auxiliary contacts	1
• note	for message "Tripped"
number of CO contacts for auxiliary contacts	0
operational current of auxiliary contacts at AC-15	
• at 24 V	3 A
• at 110 V	3 A
• at 120 V	3 A
• at 125 V	3 A
• at 230 V	2 A
• at 400 V	1A
operational current of auxiliary contacts at DC-13	
• at 24 V	2 A
• at 24 V	0.3 A
	0.22 A
• at 110 V	
• at 125 V	0.22 A
• at 220 V	0.11 A
contact rating of auxiliary contacts according to UL	B600 / R300
Protective and monitoring functions	
trip class	CLASS 10
design of the overload release	thermal
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
 at 480 V rated value 	3.2 A
 at 600 V rated value 	3.2 A
Short-circuit protection	
design of the fuse link	
 for short-circuit protection of the auxiliary switch 	fuse gG: 6 A, quick: 10 A
required	
Installation/ mounting/ dimensions	
mounting position	any
fastening method	Contactor mounting
height	76 mm
width	45 mm
depth	70 mm
Connections/ Terminals	
	No
product component removable terminal for auxiliary and control circuit	
type of electrical connection	
for main current circuit	screw-type terminals
for auxiliary and control circuit	screw-type terminals
arrangement of electrical connectors for main current	Top and bottom
circuit	rop and bottom
type of connectable conductor cross-sections	
for main contacts	
— solid or stranded	2x (0,5 1,5 mm²), 2x (0,75 2,5 mm²), 2x 4 mm²

— finely stranded with core end processing	2x (0.5 1.5 mm ²), 2x (0.75			
at AWG cables for main contacts	2x (20 16), 2x (18 14), 2x	12		
type of connectable conductor cross-sections				
for auxiliary contacts	2x(0.5, 1.5, 2x(0.75))	Q E mama ²)		
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)			
 finely stranded with core end processing 	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) 2x (20 16), 2x (18 14)			
at AWG cables for auxiliary contacts	2X (20 16), 2X (18 14)			
tightening torque	0.0			
for main contacts with screw-type terminals	0.8 1.2 N·m			
for auxiliary contacts with screw-type terminals	0.8 1.2 N·m			
design of screwdriver shaft	Diameter 5 6 mm			
size of the screwdriver tip	Pozidriv PZ 2			
design of the thread of the connection screw	140			
for main contacts	M3			
of the auxiliary and control contacts	M3			
Safety related data				
failure rate [FIT] with low demand rate according to SN 31920	50 FIT			
MTTF with high demand rate	2 280 y			
T1 value for proof test interval or service life according to IEC 61508	20 у			
protection class IP on the front according to IEC 60529	IP20			
touch protection on the front according to IEC 60529	finger-safe, for vertical contact	from the front		
Display				
display version for switching status	Slide switch			
Certificates/ approvals				
		_	For use in hazard-	
Certificates/ approvals General Product Approval			For use in hazard- ous locations	
General Product Approval				
	^m	rnr		
General Product Approval	^m (h)	FAL		
General Product Approval	n UL	EAC		
General Product Approval	n UL	EAC	ous locations	
General Product Approval	n UL	EAC	ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard-	m Que UL UL Test Certificates	EAC	ous locations	
General Product Approval	Ų,	EAC	ous locations	
General Product Approval Confirmation	Test Certificates	ERC Type Test Certific-	ous locations	
General Product Approval Confirmation	Test Certificates	ERC <u>Type Test Certific- ates/Test Report</u>	ous locations	
General Product Approval Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard-	Test Certificates		ous locations	
General Product Approval Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Image: Confirmation of Conformity Image: Confirmation of Conformity Image: Confirmation of Conformity Image:	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity Confirmation Confirmation Confirmation Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity CCC Marine / Shipping Marine / Shipping ECEL Implicit Colspan="2">Implicit Colspan="2">Confirmation	Test Certificates		ous locations	
Confirmation Confirmation Confirmation Confirmation Tor use in hazard- ous locations Declaration of Conformity CONFIRMENT CONFIRMENT Marine / Shipping ECON CONFIRMENT	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazard- ous locations Declaration of Conformity CCC Marine / Shipping Marine / Shipping ECEL Implicit Colspan="2">Implicit Colspan="2">Confirmation	Test Certificates		ous locations	
General Product Approval Confirmation Confirmation Confirmation For use in hazardo ccc Declaration of Conformity CONFORMER CONFORMER LINE LINE Marine / Shipping LINE CONFOR CONFOR CONFOR Other Other	Test Certificates		ous locations	
Confirmation Confirmation Confirmation Confirmation Tor use in hazard- ous locations Declaration of Conformity CONFIRMENT CONFIRMENT Marine / Shipping ECON CONFIRMENT	Test Certificates		ous locations	

Further information

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RU2116-1DB0

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RU2116-1DB0

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

https://support.industry.siemens.com/cs/ww/en/ps/3RU2116-1DB0


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RU2116-1DB0&lang=en


Characteristic: Tripping characteristics, I²t, Let-through current


https://support.industry.siemens.com/cs/ww/en/ps/3RU2116-1DB0/char


Further characteristics (e.g. electrical endurance, switching frequency)

http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RU2116-1DB0&objecttype=14&gridview=view1

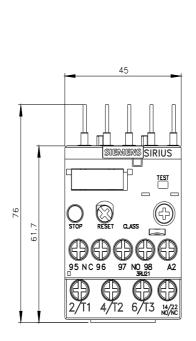

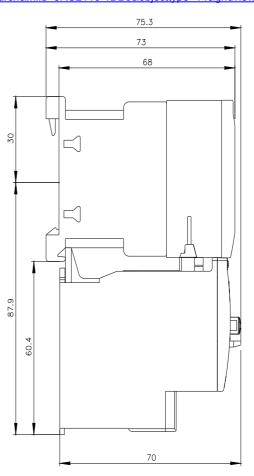

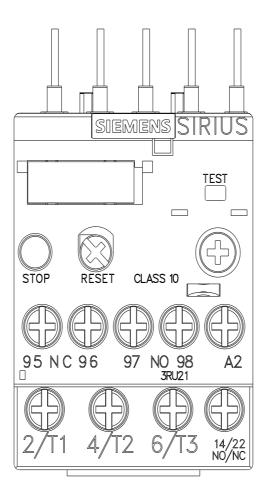

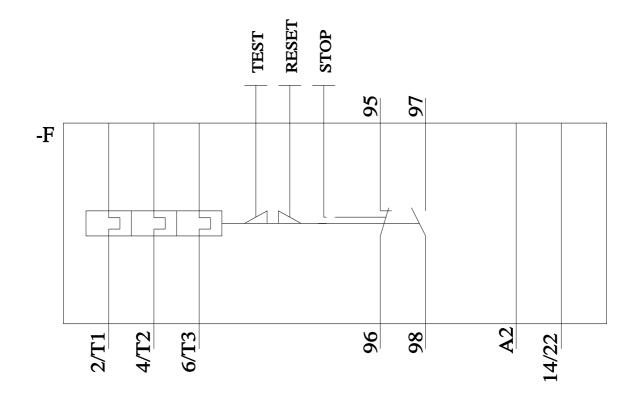

last modified:

3/8/2022 🖸